


FORM 480 AMP TRAP FUSE
 PEAK LET THRU CURRENT DATA
 100-600 AMP 600 VOLT
 CAT. NO. A4BQ(AMP RATING)
 GOULD SHAWMUT
 NEWBURYPORT, MA 01950

107063

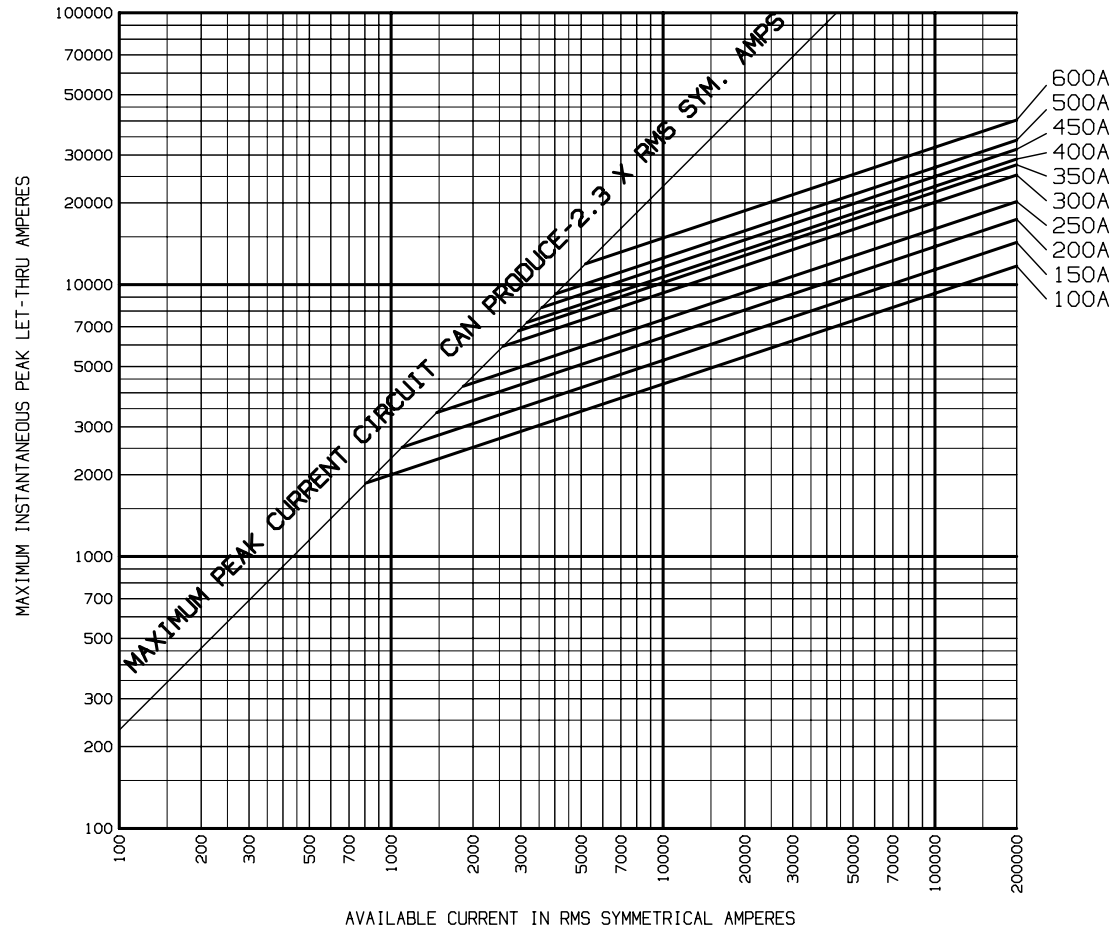

CONTROL NO.: 1091
 REV.: A
 FOLDER NO.: 2A
 DATE: 7/17/07