


TRIONIC, CLASS RK5 TIME DELAY FUSE
PEAK LET THRU CURRENT DATA
30-600 AMPS 250 VOLTS
CAT. NO. TR(AMP RATING)R(ID)
MERSEN USA NEWBURYPORT-MA, LLC
NEWBURYPORT, MA 01950

7669

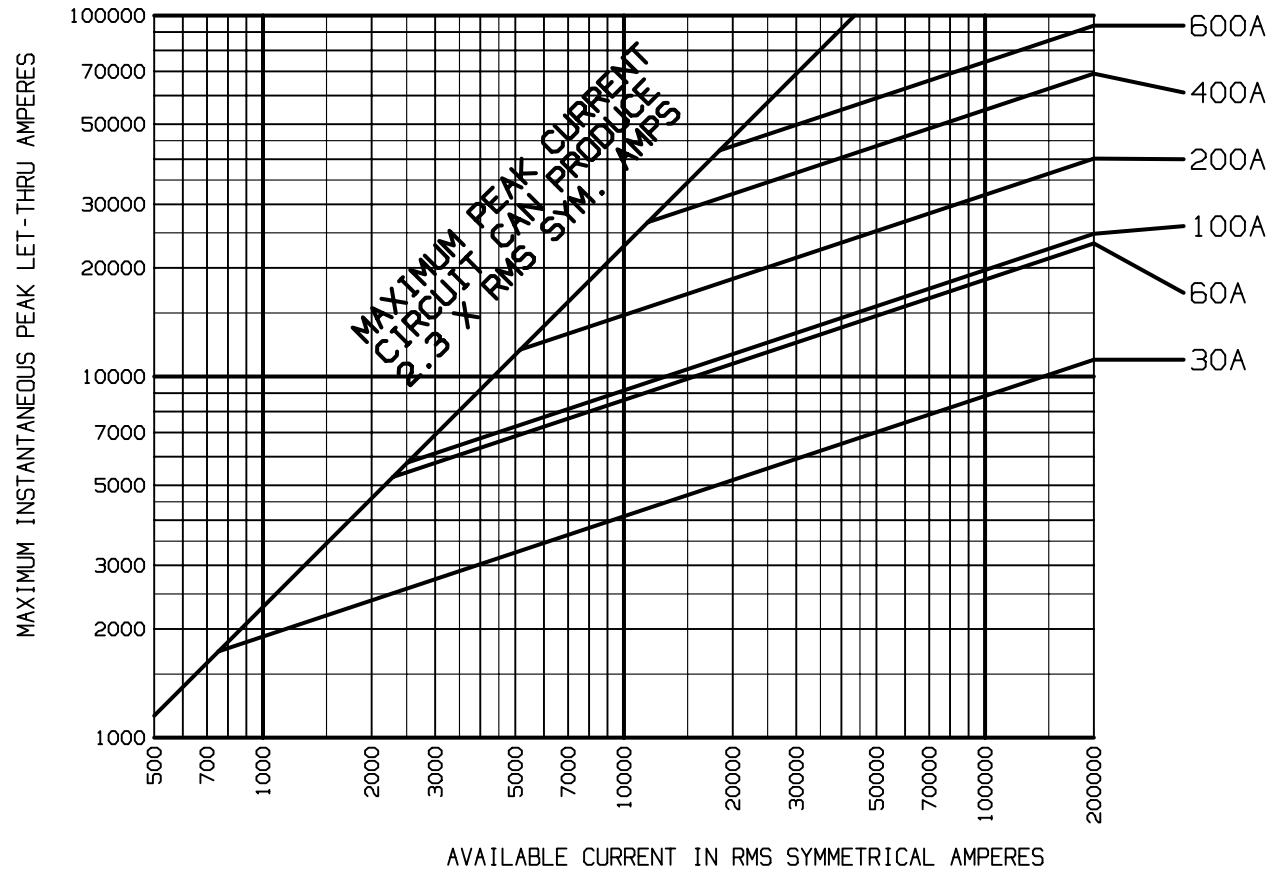

CONTROL NO.: 1259
REV.: G
FOLDER NO.: 38
DATE: 12-30-09