


AMPTRAP DUAL ELEMENT FUSE
MELTING TIME CURRENT DATA
 $\frac{1}{10}$ -8 AMPS 600 VOLT
CAT. NO. A6D (AMP RATING)R
GOULD SHAWMUT
NEWBURYPORT, MA 01950

720018

INIT REL
16 JUL 96

CURRENT IN AMPERES

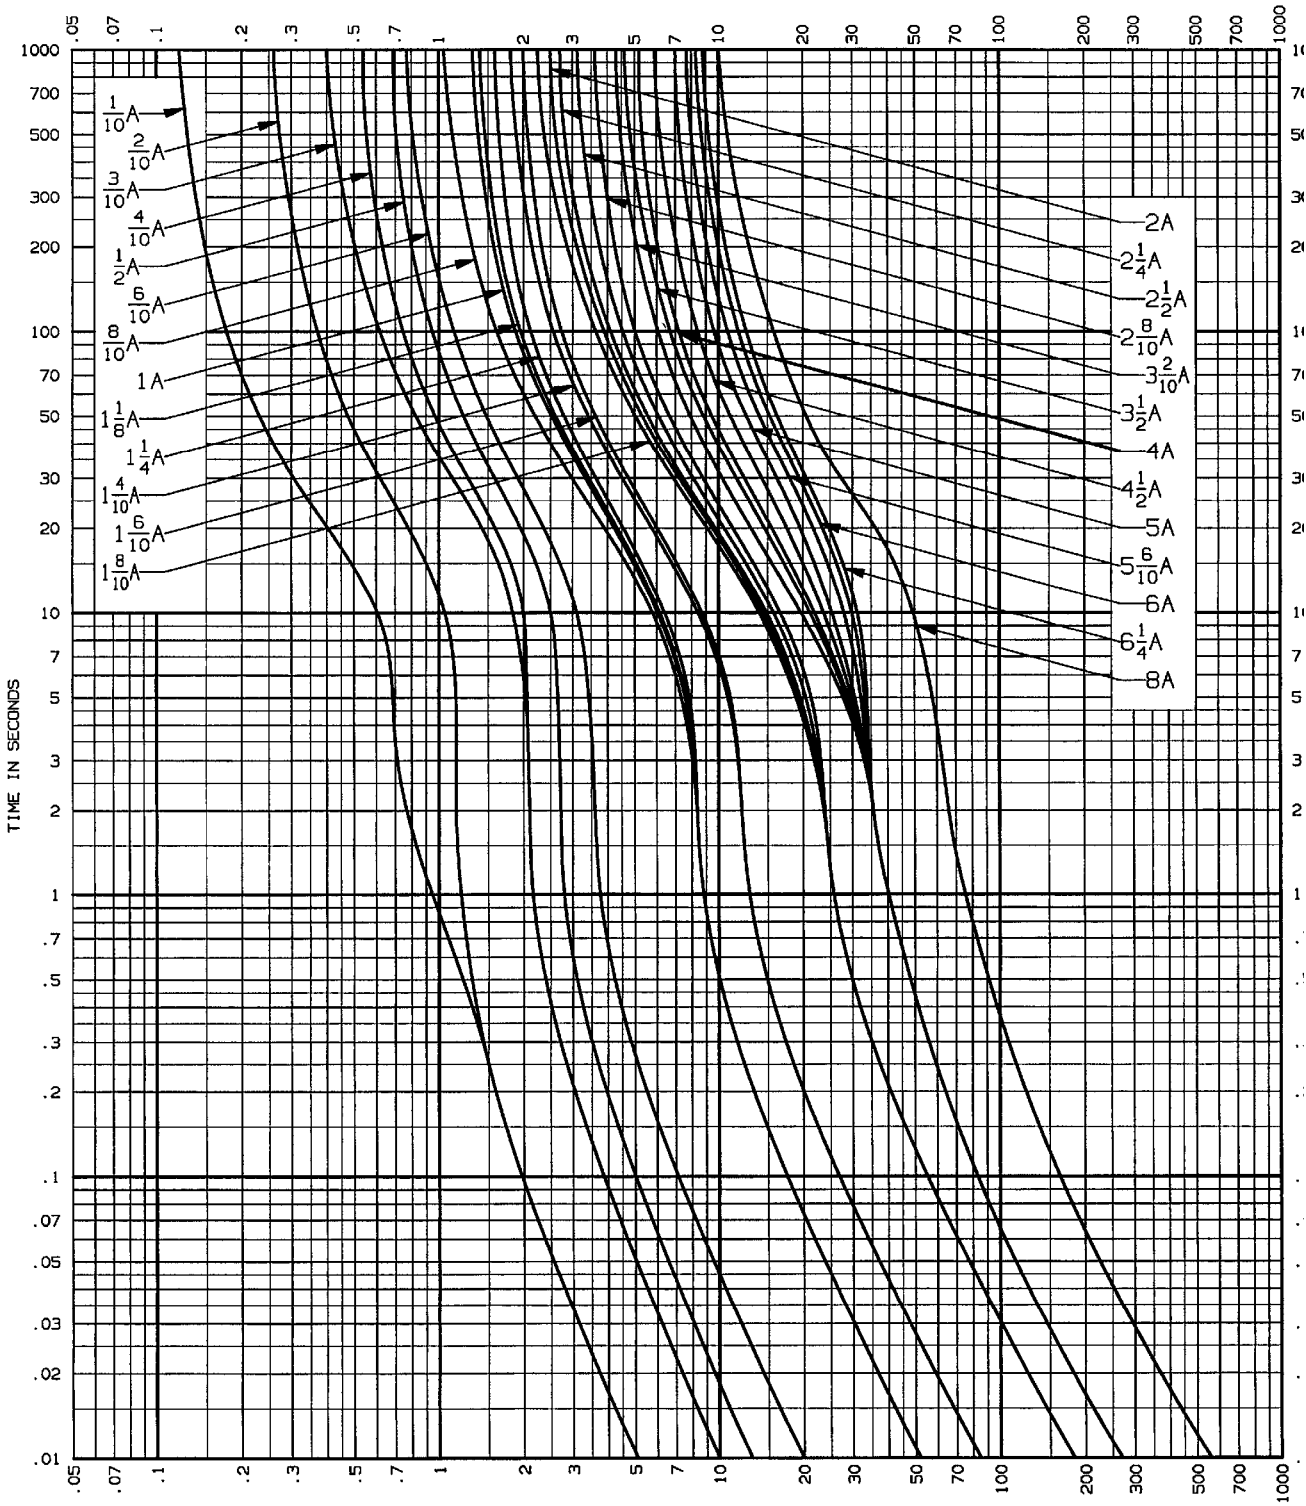

CURRENT IN AMPERES