

CABLE PROTECTOR AMP-TRAP FUSE

CL-14

A083C2D0R0-200E


200E 8.3KV

TOTAL CLEARING TIME CURRENT CURVE

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720470

CURRENT IN AMPERES X10

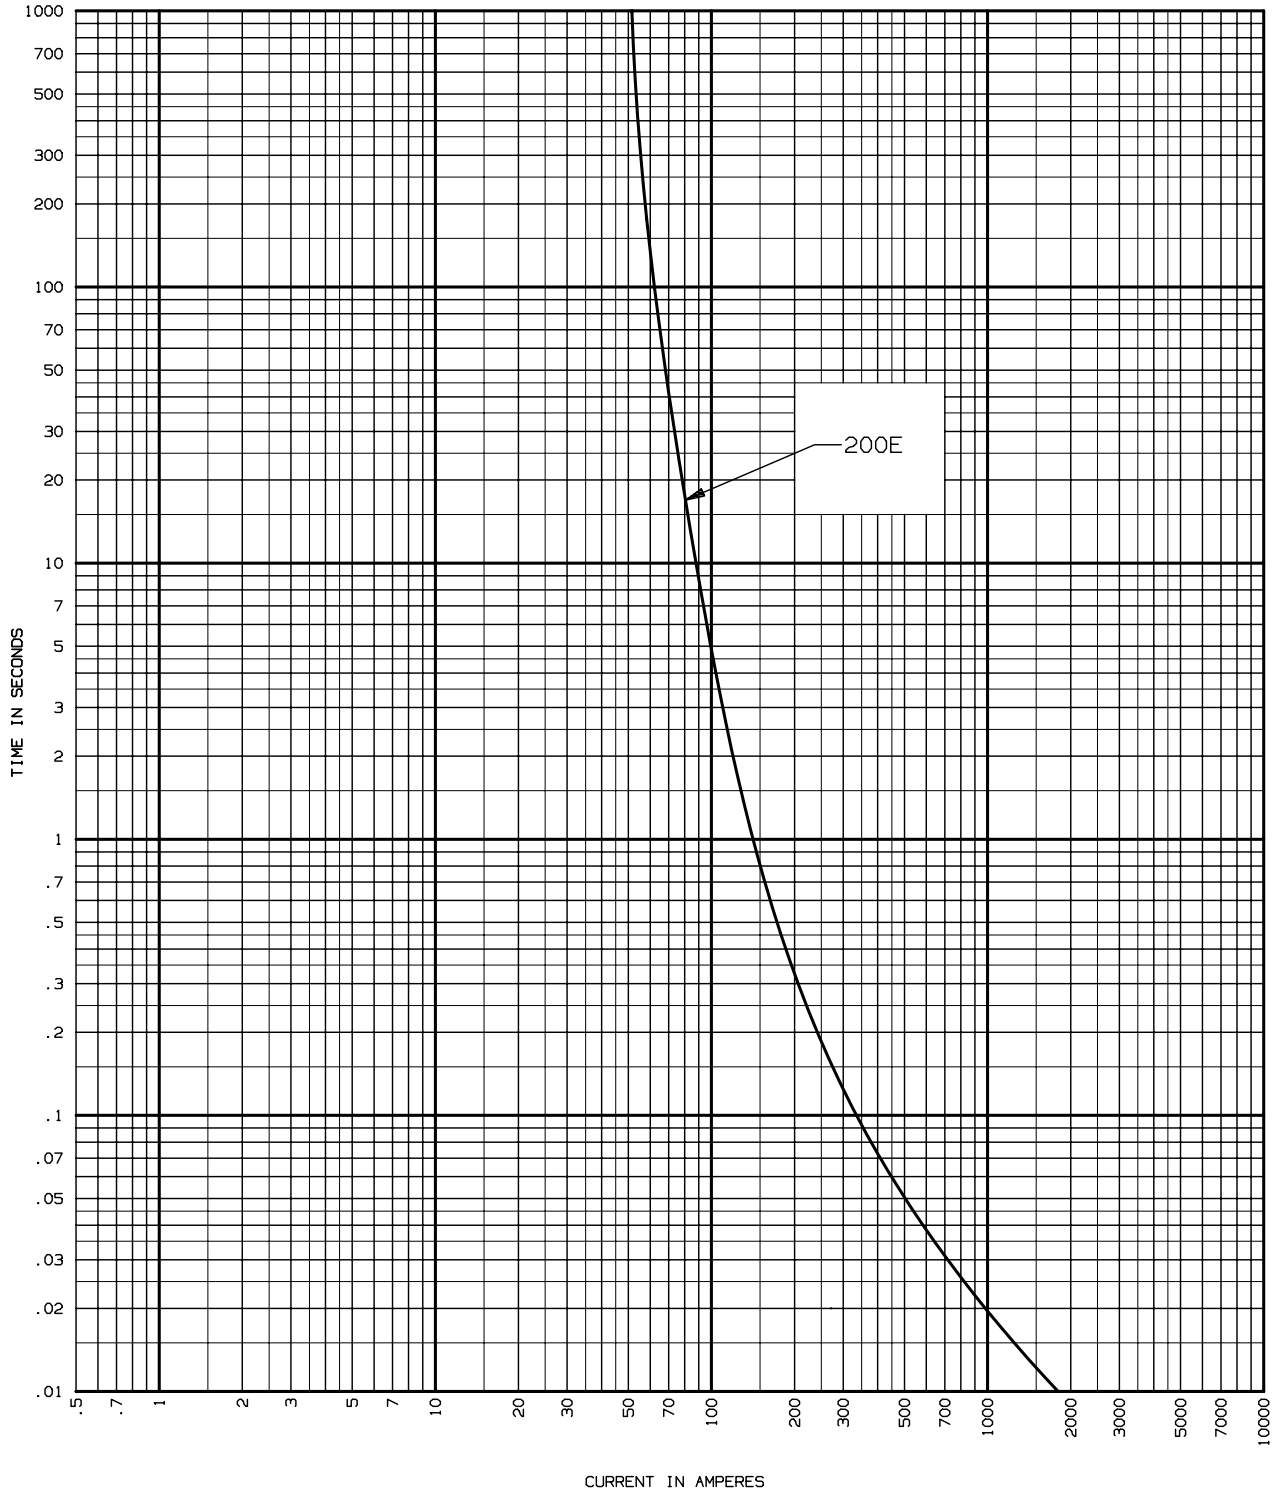

CONTROL No: 1190
FOLDER NO.: 14A
REV. A
2-13-08