

MEDIUM VOLTAGE CAPACITOR FUSE


CAT. NO. A150C(100-200)-40

100-200A 1.5kV

TOTAL CLEARING TIME CURRENT DATA

FERRAZ SHAWMUT
NEWBURYPORT, MA 01950

720571

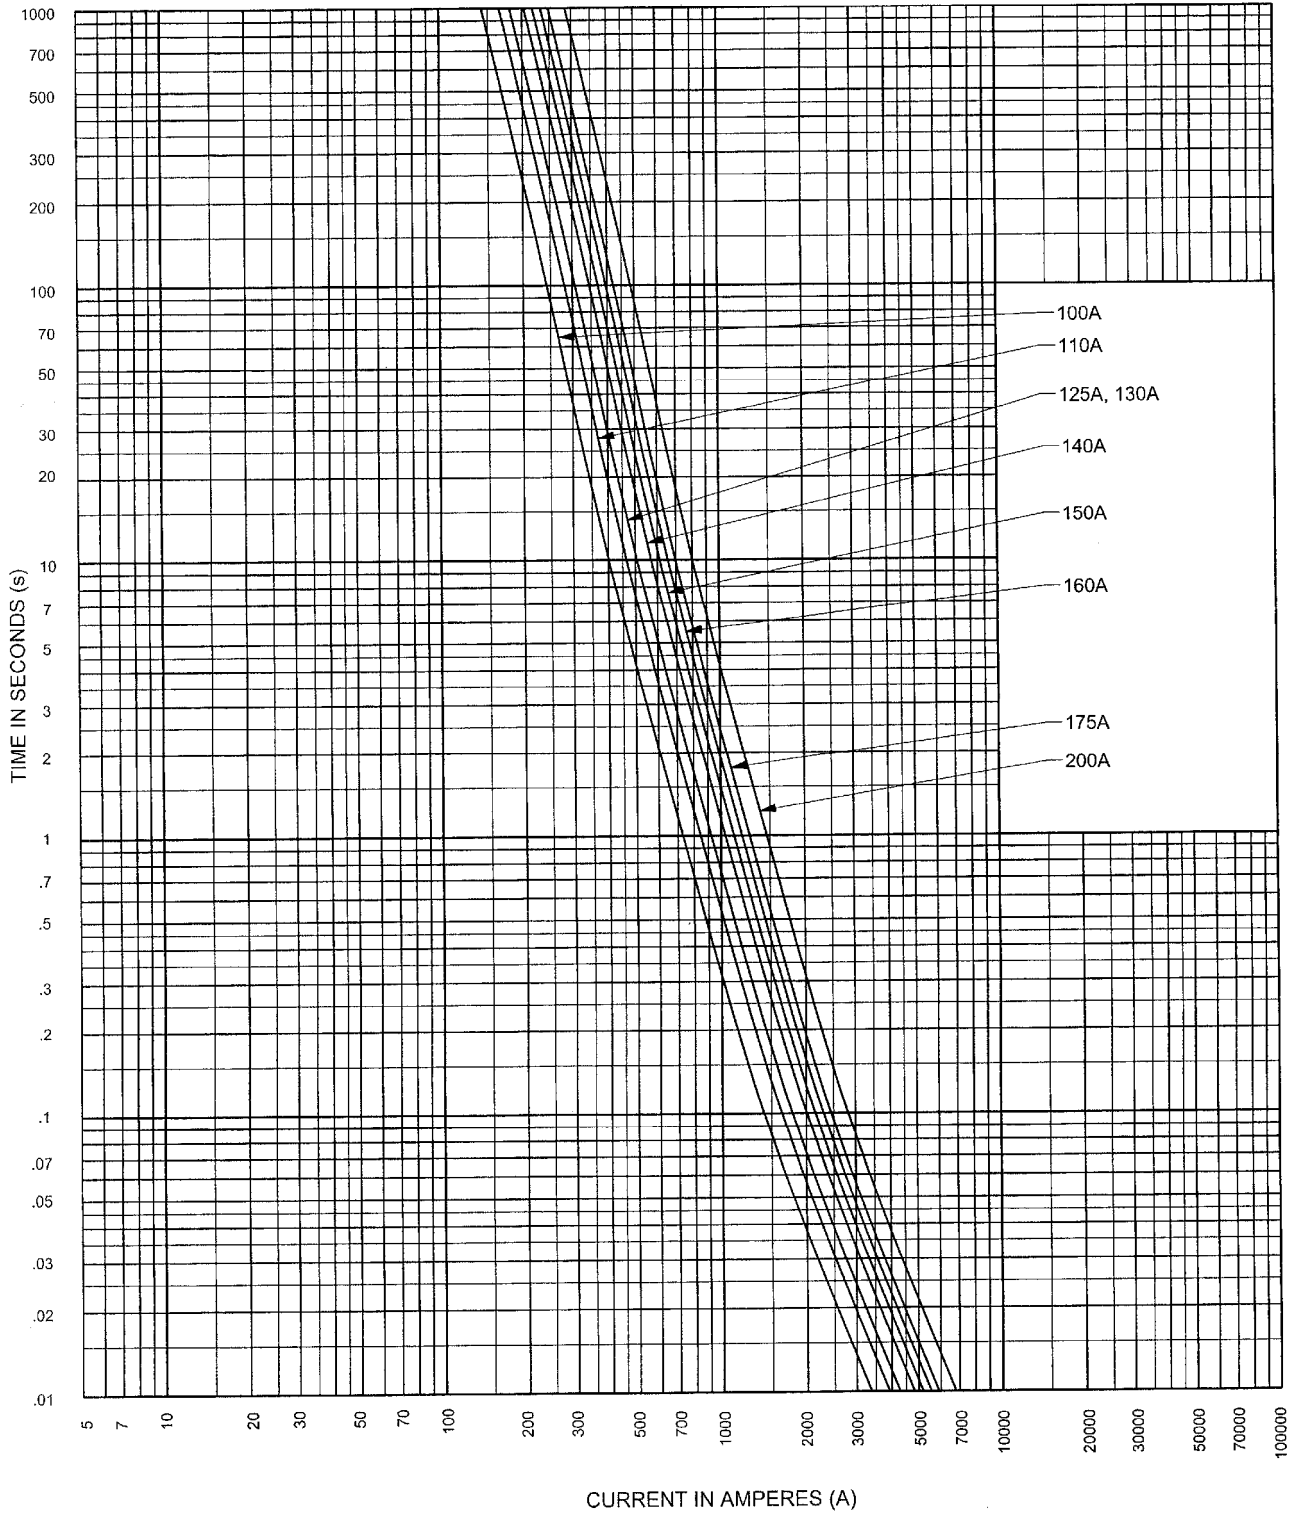

CONTROL NO.: 829
REV.: A
FOLDER NO.: 47
DATE: 9-14-05