


TRIONIC, CLASS RK5 TIME DELAY FUSE  
 PEAK LET THRU CURRENT DATA  
 30-600 AMPS 250 VOLTS  
 CAT. NO. TR(AMP RATING)R(ID)  
 MERSEN USA NEWBURYPORT-MA, LLC  
 NEWBURYPORT, MA 01950

7669

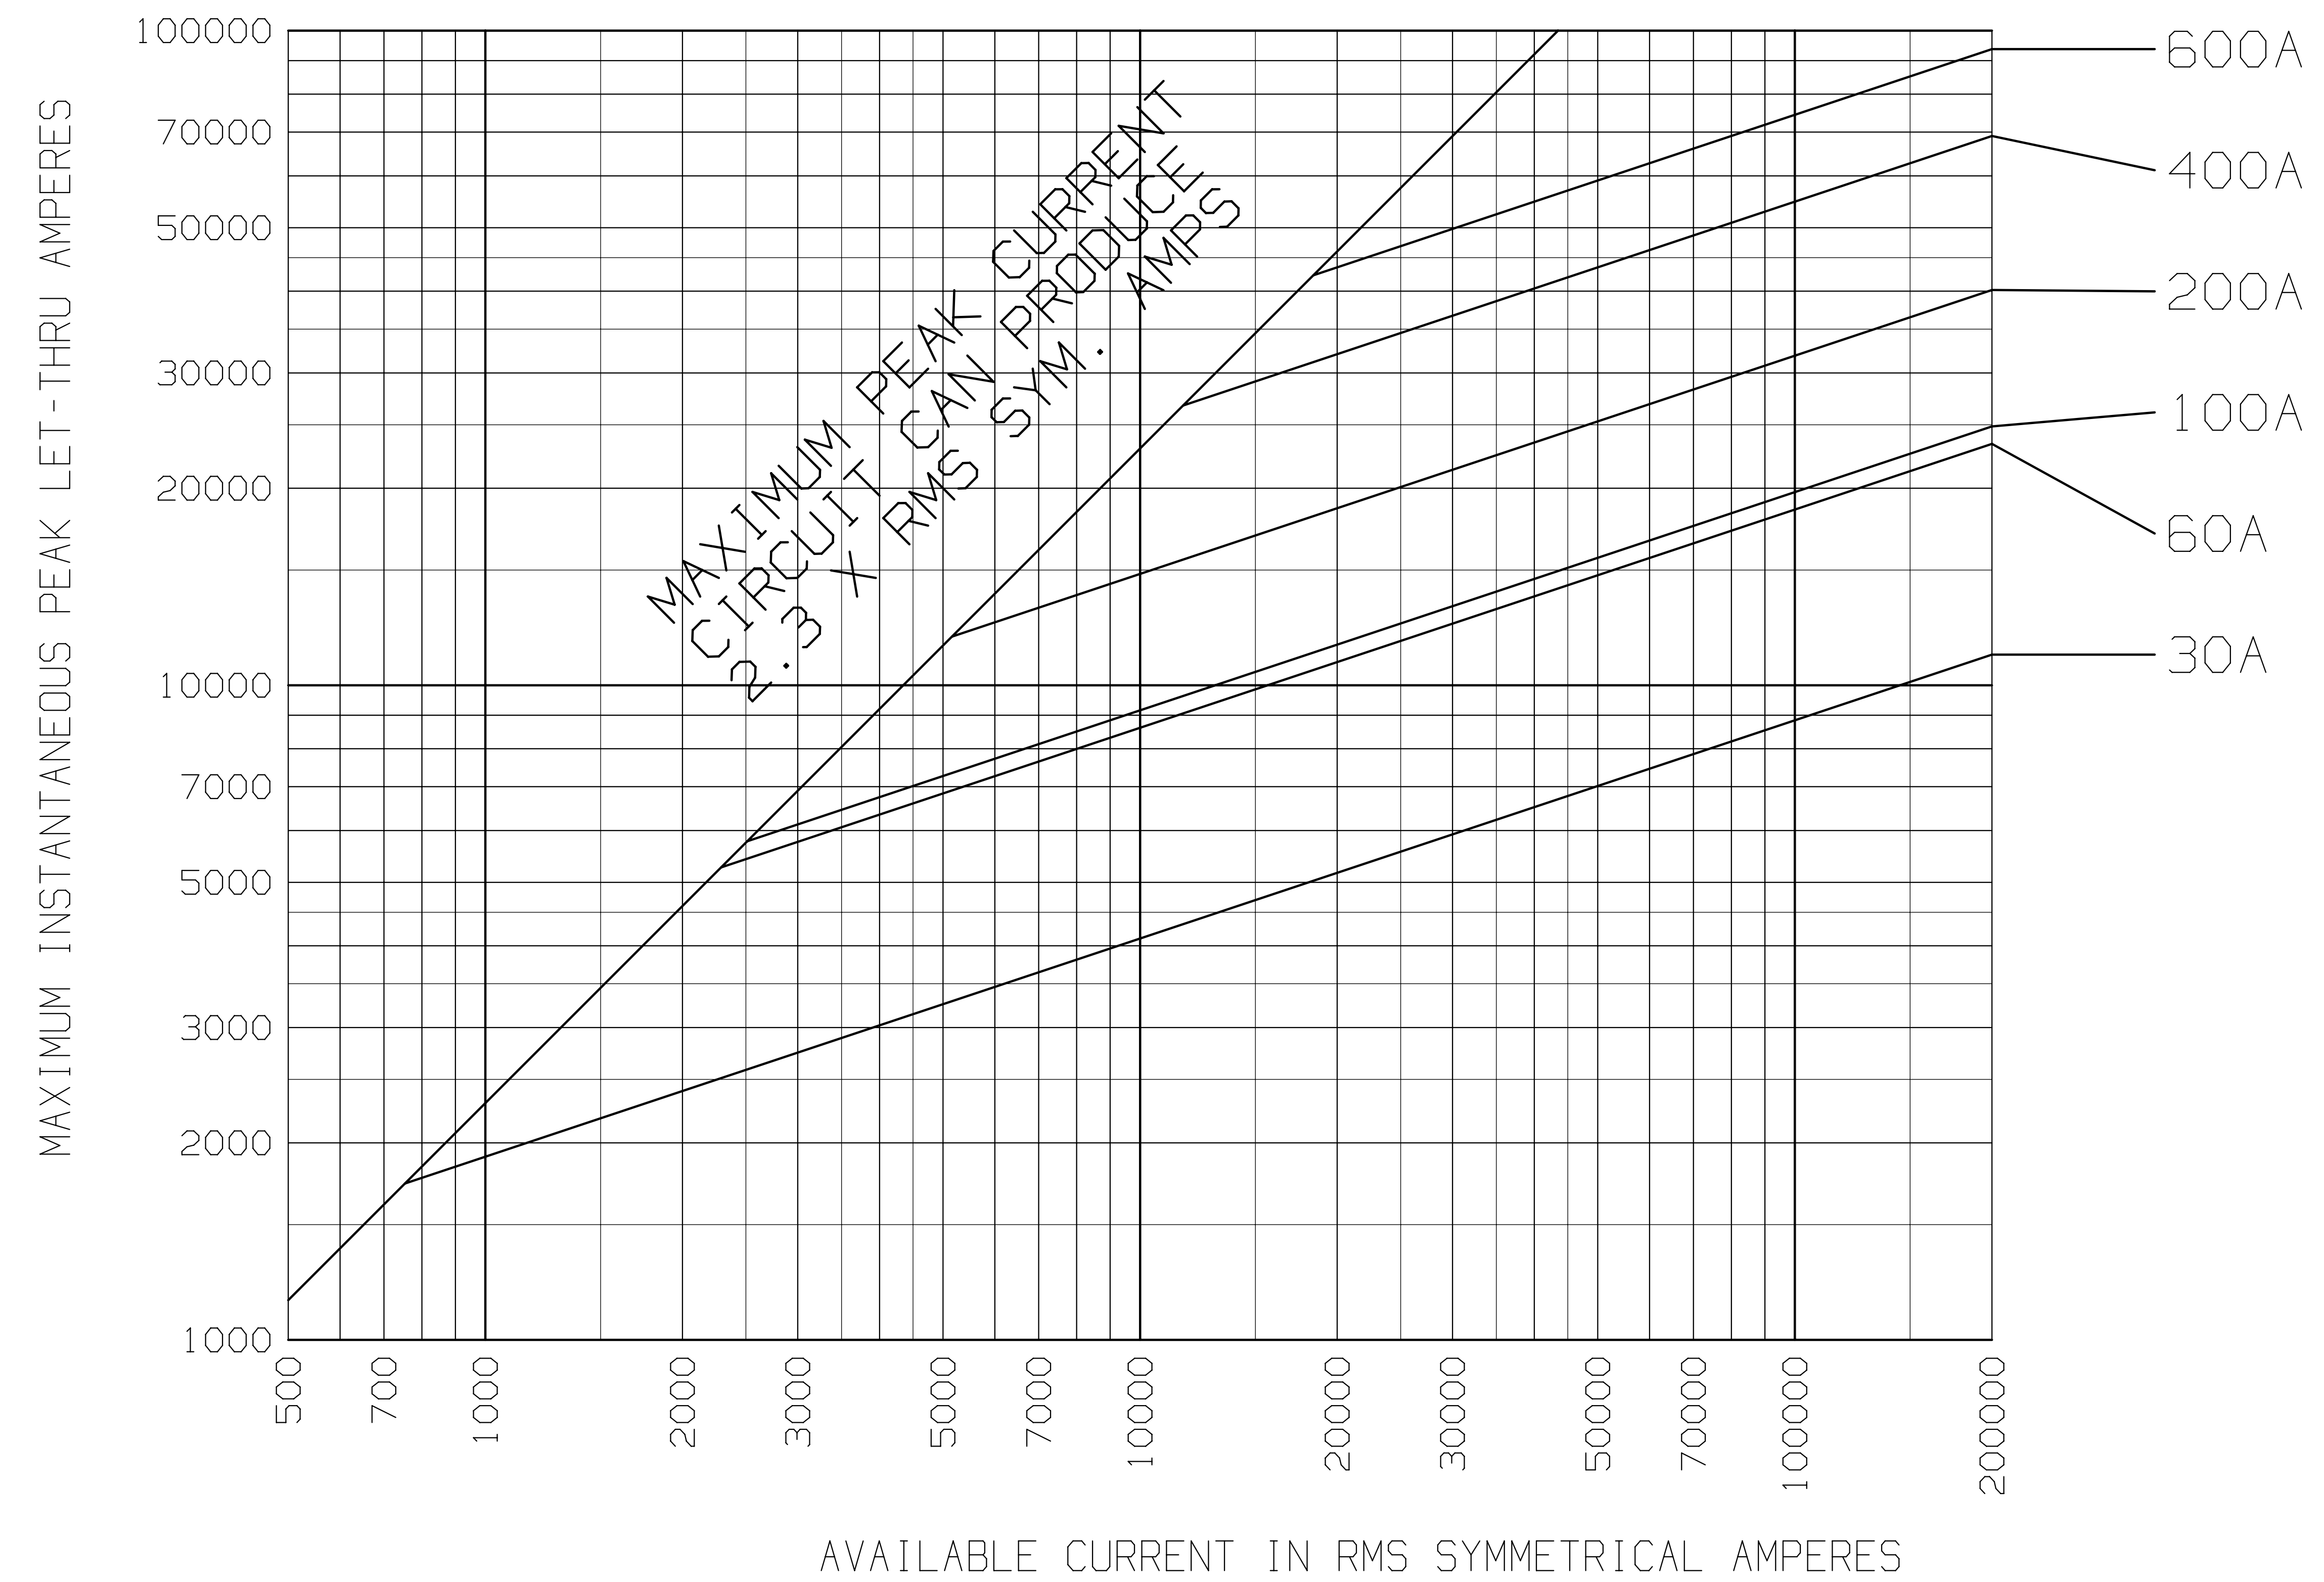

CONTROL NO.: 1259  
 REV.: G  
 FOLDER NO.: 38  
 DATE: 12-30-09